

MITSUBISHI

General-Purpose AC Servo

MELSERVO

HEAT SINK OUTSIDE MOUNTING ATTACHMENT

MR-J3ACN


Installation Guide

1. INTRODUCTION


Thank you for choosing the heat sink outside mounting attachment designed for Mitsubishi AC servo. The heat sink outside mounting attachment is used to install the heat sink of a servo amplifier in the outside of a control box.

Handling method for the heat sink outside mounting attachment is indicated in the instruction manual for each servo amplifier. Read the instruction manual carefully to use the heat sink outside mounting attachment.

2. PANEL CUT DIMENSIONS

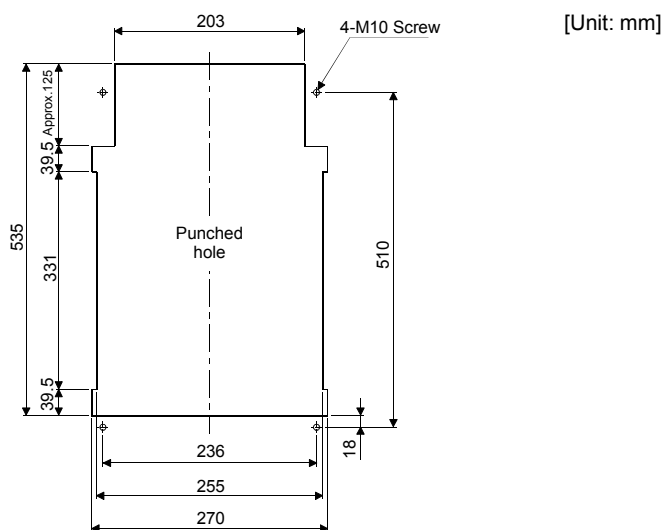

3. OUTLINE DIMENSION DRAWING

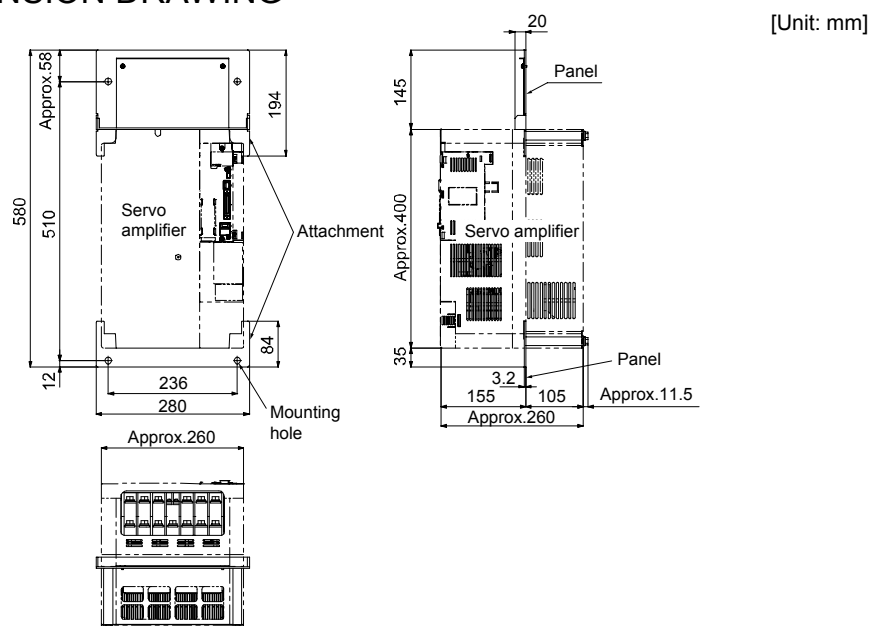

 MITSUBISHI ELECTRIC CORPORATION

HEAD OFFICE: TOKYO BLDG MARUNOUCHI TOKYO 100-8310

This installation guide uses recycled paper.

Specifications are subject to change without notice.